
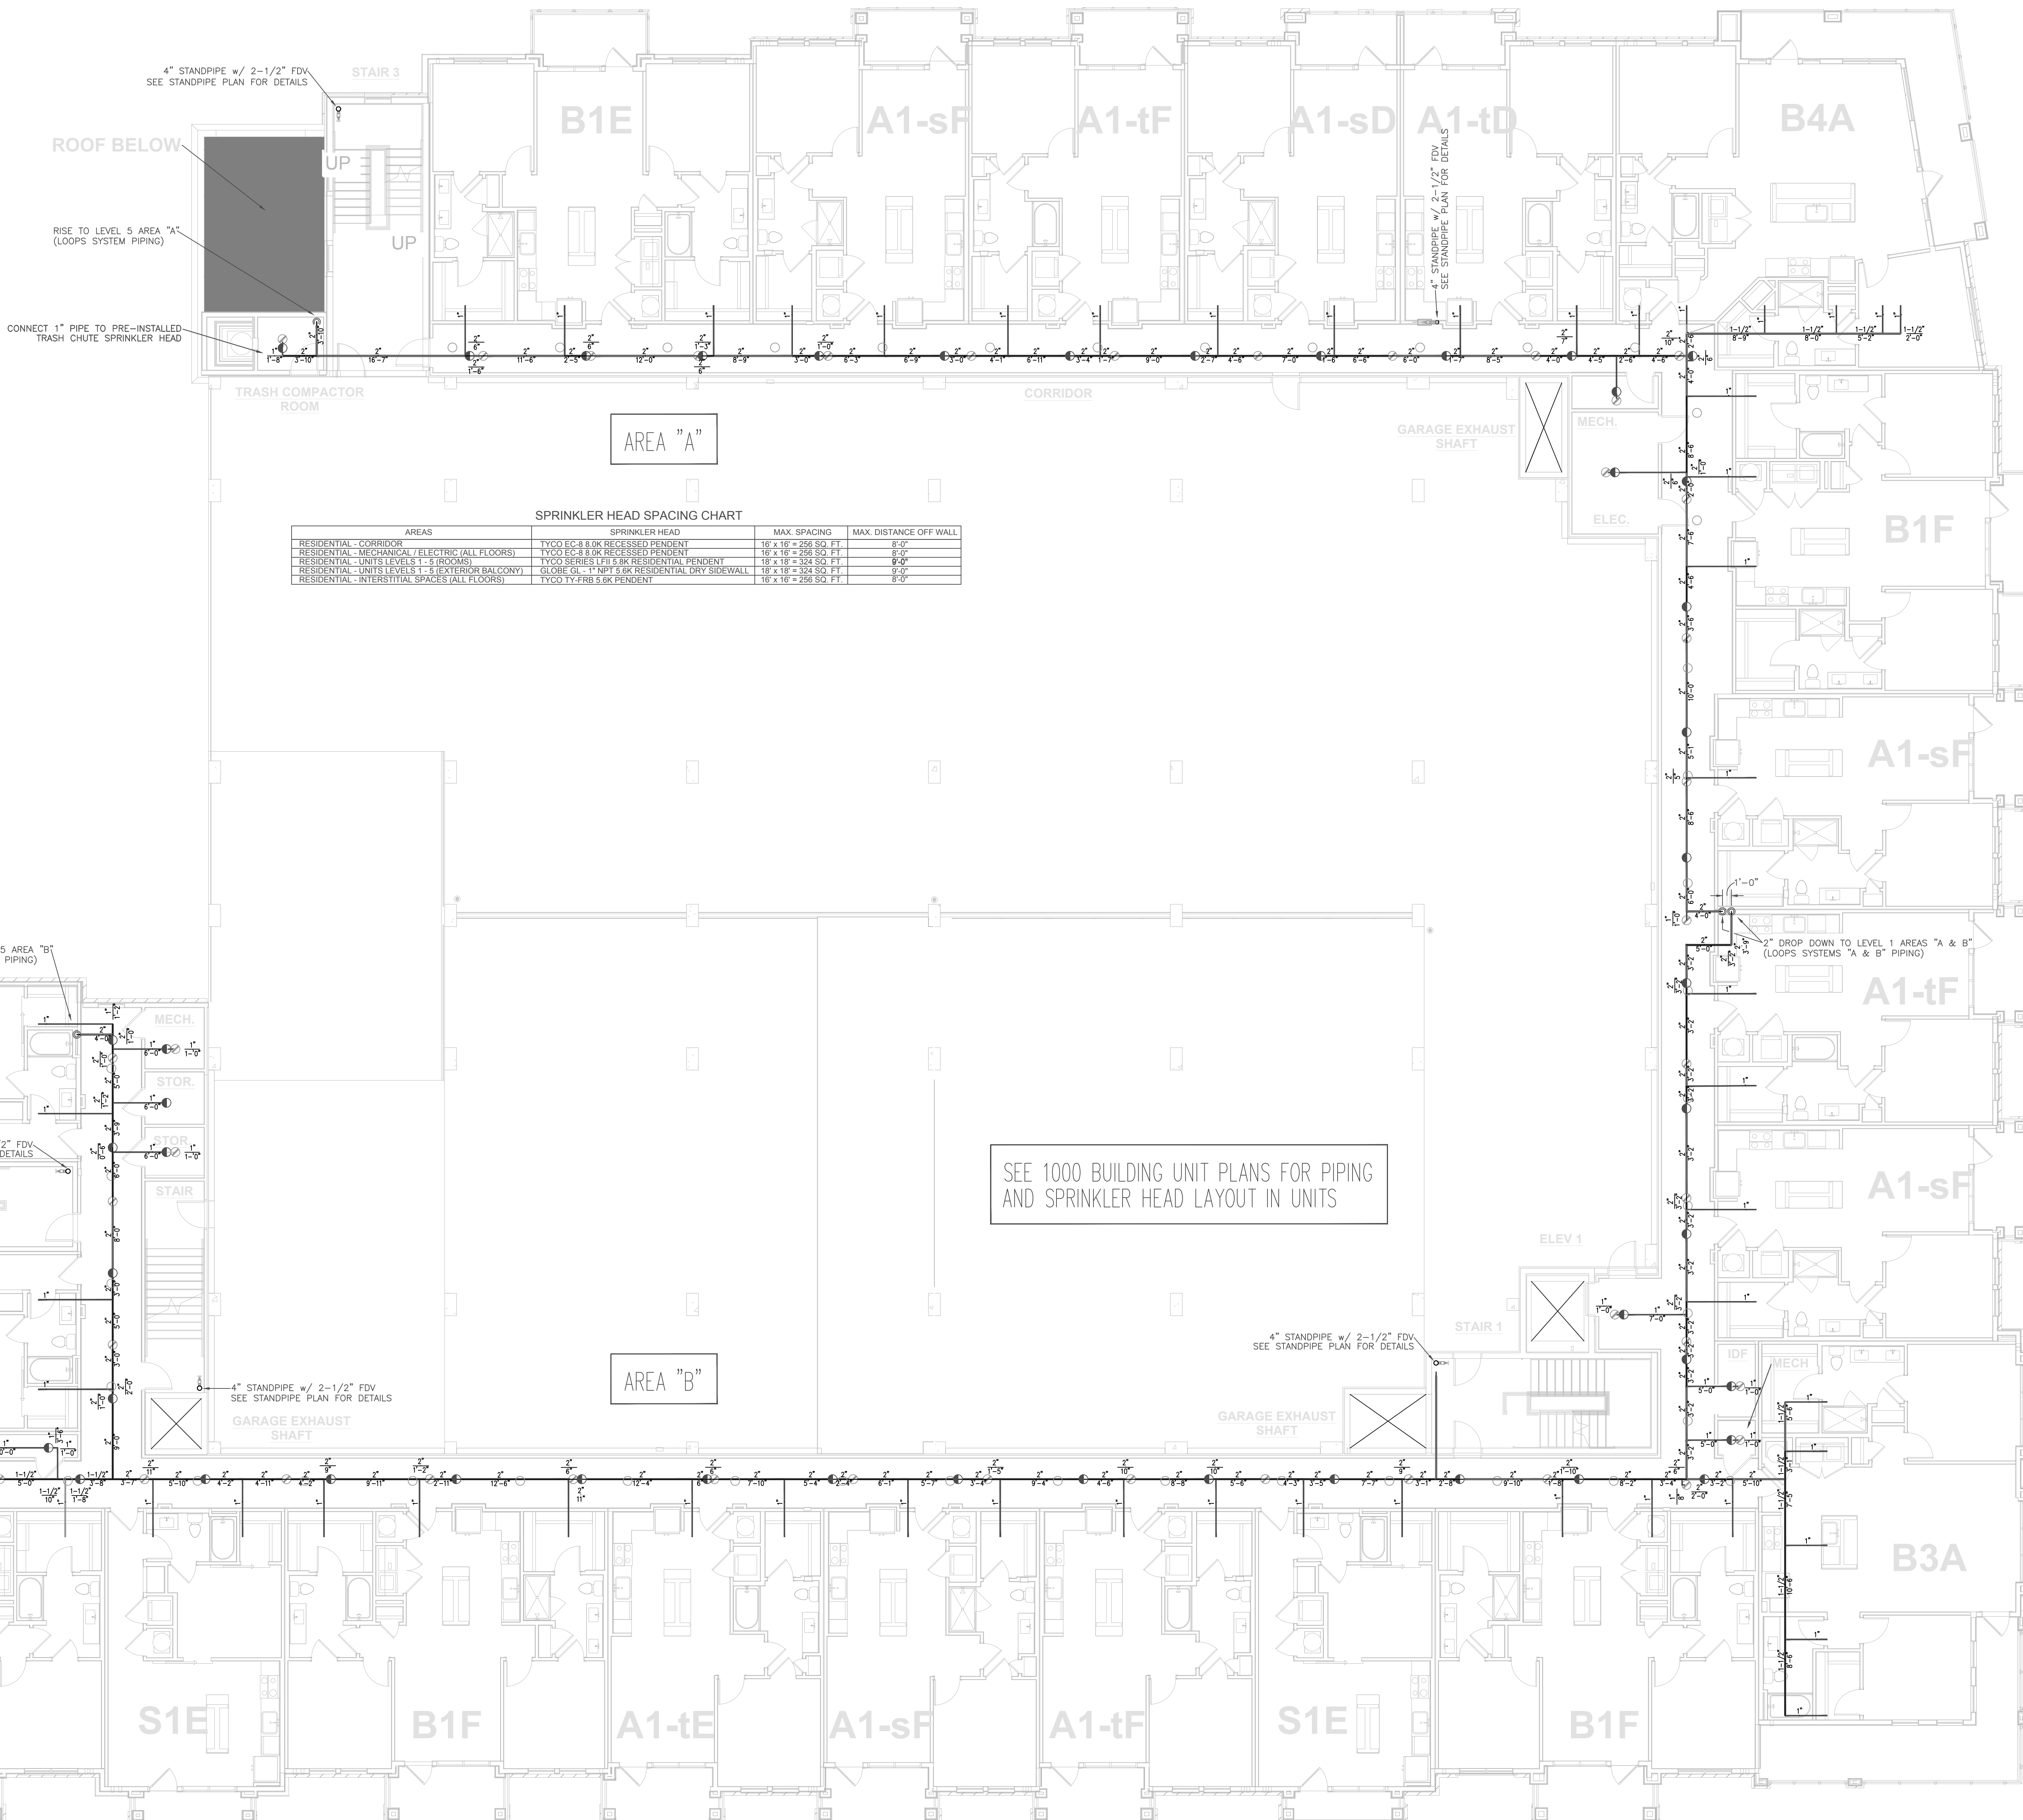
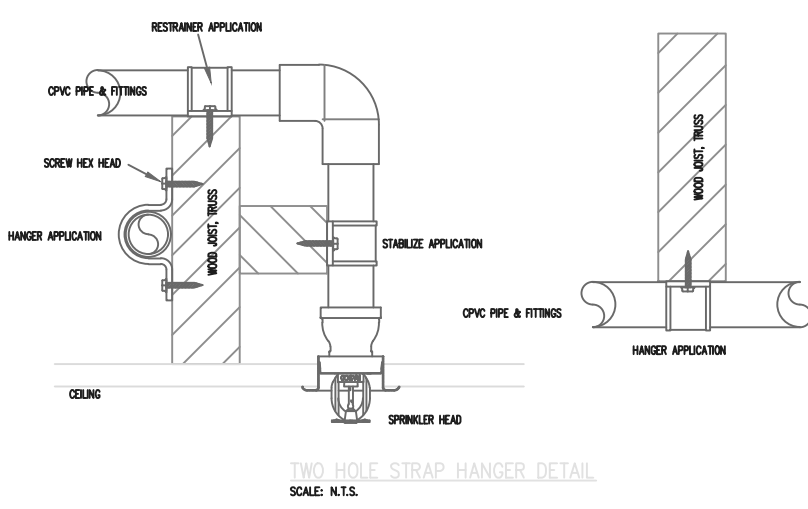


HANGER SPACING CHART

PIPE TYPE	1"	1 1/4"	1 1/2"	2"	2 1/2"	3"	4"	6"
BLACK STEEL SCH. 40	12'-0"	12'-0"	12'-0"	12'-0"	12'-0"	12'-0"	12'-0"	12'-0"
BLACK STEEL SCH. 40	12'-0"	12'-0"	12'-0"	12'-0"	12'-0"	12'-0"	12'-0"	12'-0"
CPVC	8'-0"	8'-0"	7'-0"	8'-0"	8'-0"	8'-0"	8'-0"	8'-0"

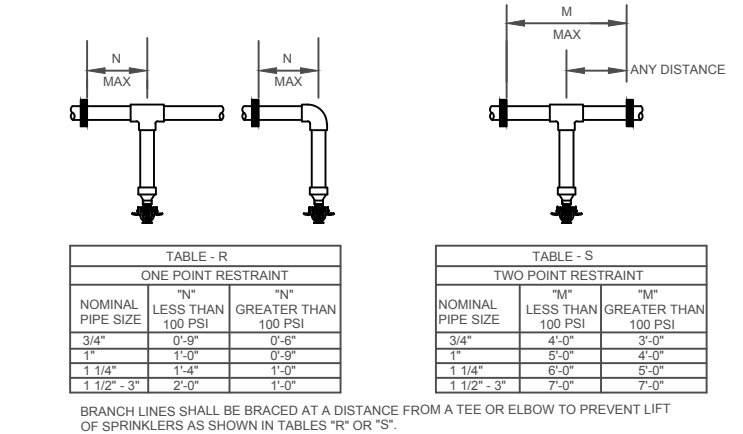

SPRINKLER HEAD SPACING CHART

AREAS	SPRINKLER HEAD	MAX. SPACING	MAX. DISTANCE OFF WALL
RESIDENTIAL - CORRIDOR	TYCO EG-8 8.0K RECESSED PENDENT	18' x 18' = 286 SQ. FT.	8'-0"
RESIDENTIAL - MECHANICAL / ELECTRIC (ALL FLOORS)	TYCO EG-8 8.0K RECESSED PENDENT	18' x 18' = 286 SQ. FT.	8'-0"
RESIDENTIAL - UNITS LEVELS 1-5 (ROOMS)	TYCO SERIES T-FJ 8.0K RESIDENTIAL PENDENT	18' x 18' = 324 SQ. FT.	8'-0"
RESIDENTIAL - UNITS LEVELS 1-5 (EXTERIOR BALCONY)	GLOBE GL-11 70P 5.0K RESIDENTIAL DRY SIDEWALL	18' x 18' = 324 SQ. FT.	8'-0"
RESIDENTIAL - INTERSTITIAL SPACES (ALL FLOORS)	TYCO TY-FRB 5.0K PENDENT	18' x 18' = 286 SQ. FT.	8'-0"

SEE 1000 BUILDING UNIT PLANS FOR PIPING AND SPRINKLER HEAD LAYOUT IN UNITS

**BUILDING 1000 LEVEL 4**  
SCALE: 1/8" = 1'-0"

NICET Level IV Automatic Sprinkler System Layout Certification #79357  
Richard P. Kossler

Riverside Jacksonville @ Bishopgate  
Jacksonville, Florida  
1000 BUILDING - LEVEL 4 SPRINKLER

**SFP**  
Sawyer Fire Protection  
2220 COUNTY RD. 210 WEST  
SUITE NO. 108-139  
JACKSONVILLE, FL 32259  
TEL: 904-452-9227

REVISIONS & APPROVALS

NO.	DATE	BY	DESCRIPTION
1	8/27/18	ISSUE FOR PERMIT	

SYMBOLS

SYMBOL	DESCRIPTION
○	TYCO EG-8 8.0K RECESSED PENDENT
○	TYCO SERIES T-FJ 8.0K RESIDENTIAL PENDENT
○	GLOBE GL-11 70P 5.0K RESIDENTIAL DRY SIDEWALL
○	TYCO TY-FRB 5.0K PENDENT

TOTAL SPRINKLERS: 2  
TOTAL UNITS: 2  
LEVEL: 4  
JACKSONVILLE

SCALE: 1/8" = 1'-0"  
JOB NUMBER: 690  
DATE: 8/1/2018