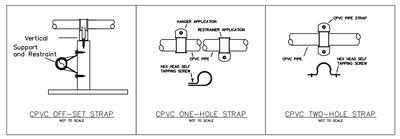

CPVC OFF-SET STRAP
NOT TO SCALE

CPVC ONE-HOLE STRAP
NOT TO SCALE

CPVC TWO-HOLE STRAP
NOT TO SCALE



WOOD SIDEWINDER HANGER
NOT TO SCALE

HANGER SPACING CHART								
PIPE TYPE	1"	1 1/4"	1 1/2"	2"	2 1/2"	3"	4"	6"
BLACK STEEL SCH. 10	12'-0"	12'-0"	15'-0"	15'-0"	15'-0"	15'-0"	15'-0"	15'-0"
BLACK STEEL SCH. 40	12'-0"	12'-0"	15'-0"	15'-0"	15'-0"	15'-0"	15'-0"	15'-0"
CPVC	6'-0"	6'-6"	7'-0"	8'-0"	9'-0"	10'-0"	-	-

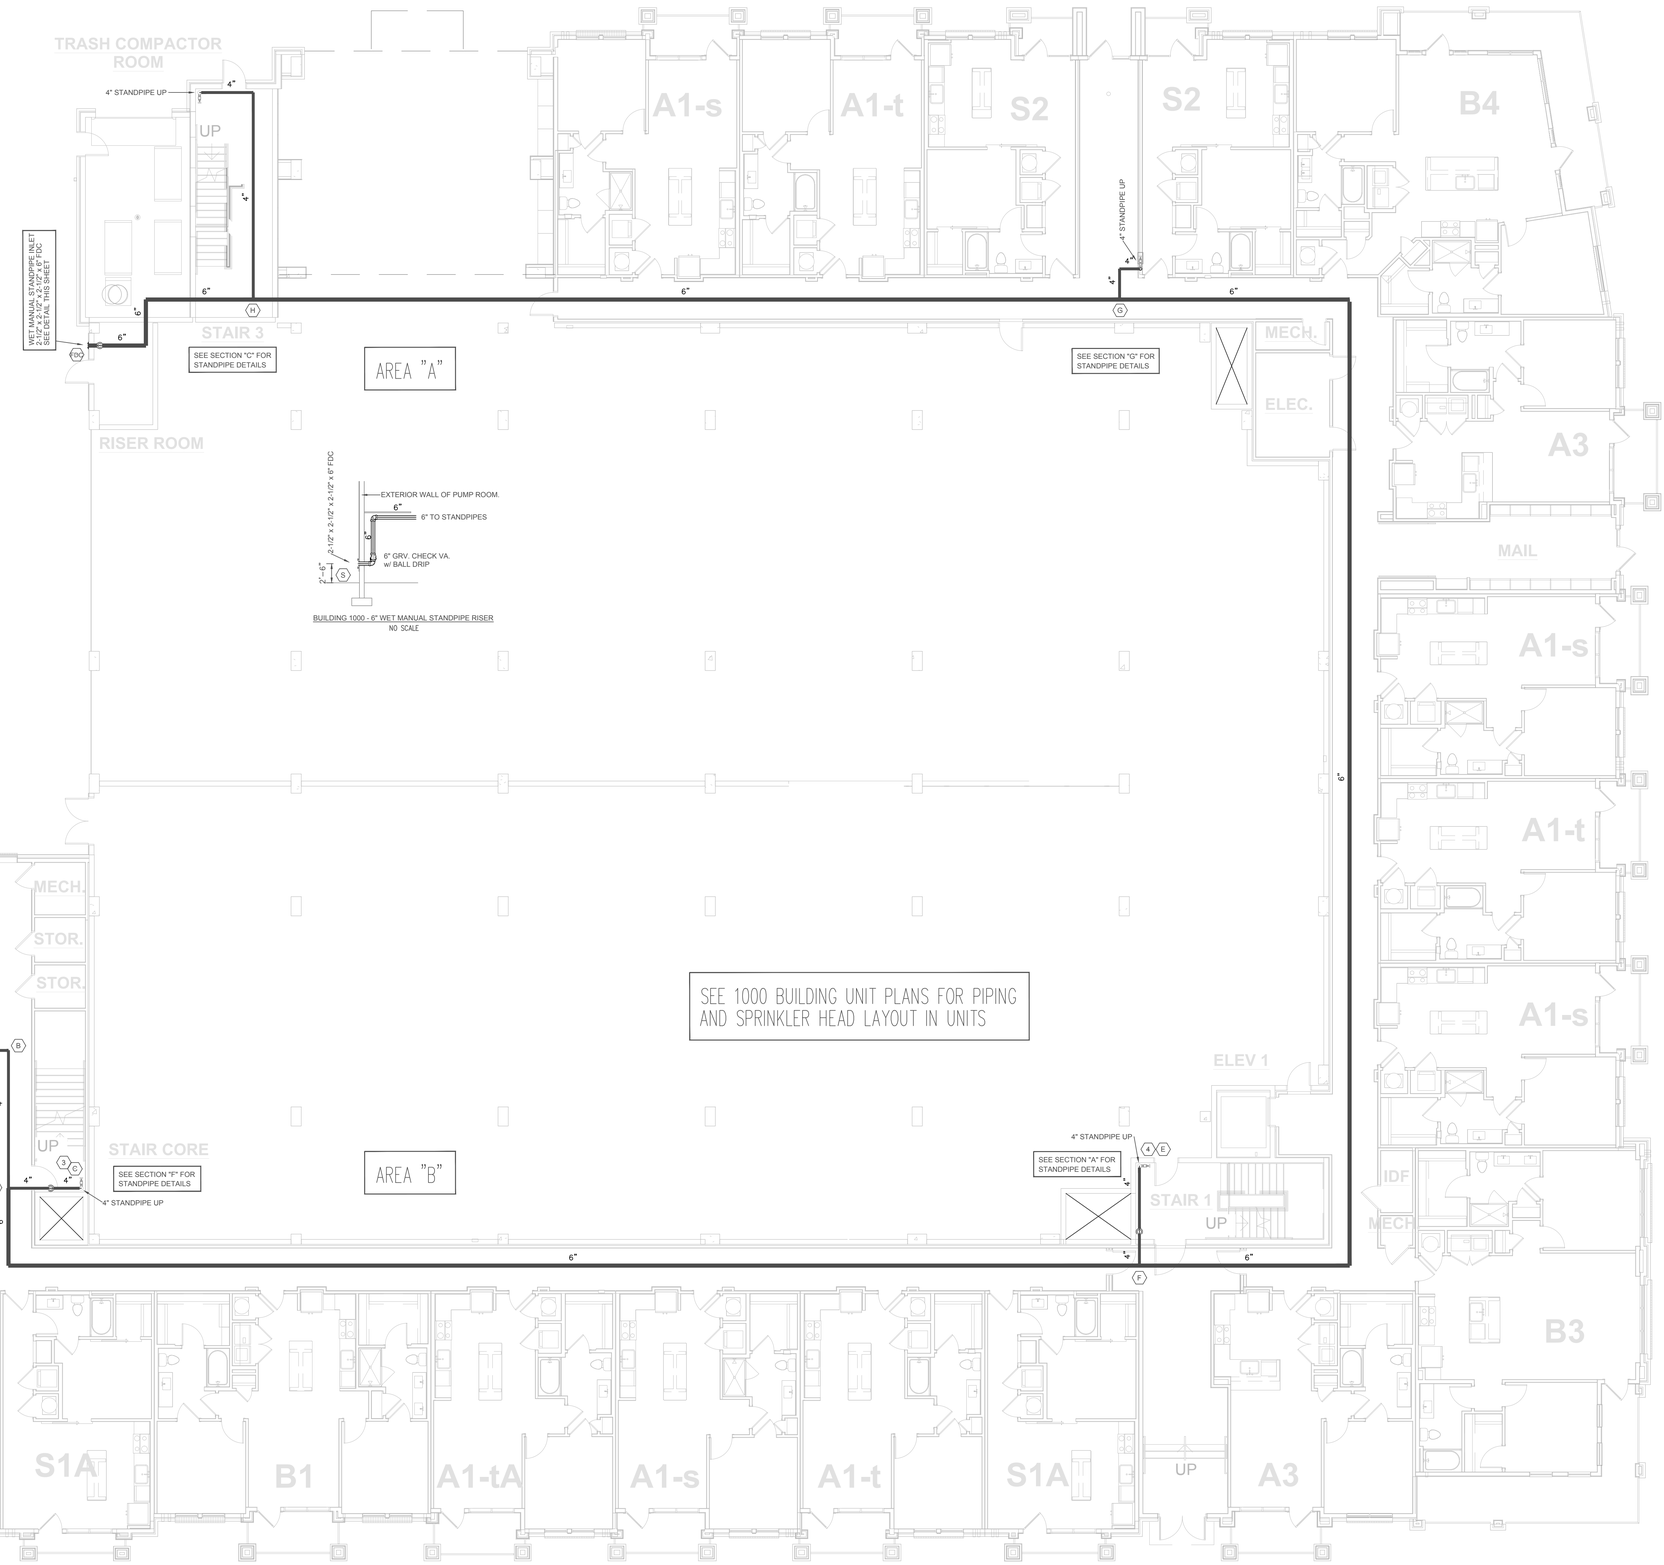

BUILDING 1000 - 6" WET MANUAL STANDPIPE RISER

NO SCALE

NOTE: ALL PIPING TO BE SCHEDULE 10 BLACK STEEL

NICET Level IV Automatic Sprinkler System Layout Certification #79357
Richard P. Kossler

Riverside @ Bishops Gate

Jacksonville, Florida

BUILDING 2000 - STANDPIPE MAIN AND DETAILS

Suwannee Fire Protection
2220 COUNTY RD. 210 WEST
SUITE NO.108-139
JACKSONVILLE, FLORIDA 32259
PH: 904-626-5257

NO.	DATE	BY	REVISIONS & APPROVALS DESCRIPTION
	8/21/18		ISSUE FOR PERMIT

SYM.	QUAN.	SPK #	KIT TEMP	DESCRIPTION
				AHJ: CITY OF JACKSONVILLE
				TOTAL NO. OF SYSTEMS 1
				TOTAL SPRINKLERS ON ADD 1,004
				WET PIPE SYSTEM NFPA #13

SCALE: AS NOTED
JOB NUMBER: 690
DATE: 8/14/2018

FP-3A
8 of 21